

**SPORE SAMPLING REPORT
FOR
GLENWOOD MIDDLE SCHOOL
2680 ROUTE 97
GLENWOOD, MD 21738**

PREPARED FOR:

**HOWARD COUNTY PUBLIC SCHOOL SYSTEM
10910 ROUTE 108
ELLCOTT CITY, MD 21043**

PREPARED BY:



**ARIA ENVIRONMENTAL, INC.
PO BOX 286
WOODBINE, MD 21797**

JUNE 29, 2016

150876

**SPORE TRAP SAMPLING REPORT
FOR GLENWOOD MIDDLE SCHOOL
JUNE 15, 2016**

TABLE OF CONTENTS

EXECUTIVE SUMMARY	i
I. BACKGROUND	1
II. OBSERVATIONS AND MEASUREMENTS	1
A. Observations and Measurements on June 15, 2016	1
B. Air Monitoring for Fungal Identification and Counting on June 15, 2016	4
III. CONCLUSIONS AND RECOMMENDATIONS	7
IV. LIMITATIONS.....	8

Tables

Table 1 – Acceptable Ranges of Temperature and Relative Humidity in Summer and Winter

Table 2 – Temperature, Relative Humidity, Carbon Dioxide and Carbon Monoxide Measurements Collected on June 15 in Selected Classrooms at Glenwood Middle School

Table 3 – Results of Spore Trap Sampling in Selected Classrooms at Glenwood Middle School on June 15

Table 4 – Results of Spore Trap Sampling in Portable Classrooms at Glenwood Middle School on June 15

Table 5 – Summary of Spore Sampling Results to Date at GMS in the 2015-2016 School Year

Attachments

- A: Building Layout and Sample Location Plan for June 15, 2016
- B: Report of Analysis and Chain of Custody Forms June 15, 2016

**SPORE TRAP SAMPLING REPORT
FOR GLENWOOD MIDDLE SCHOOL
June 15, 2016**

EXECUTIVE SUMMARY

Aria Environmental, Inc. (AE) was contracted by Howard County Public School System to perform spore trap sampling at the Glenwood Middle School at the end of August 2015 due to air quality concerns expressed by staff and parents and to monitor the school after a heating, ventilation and air-conditioning (HVAC) system upgrade performed in summer, 2015. AE made measurements for temperature, humidity, carbon monoxide and carbon dioxide and collected microbial spore trap sampling for fungal spore identification and counting on June 15, 2016 as part of a series of spore sampling events that will occur regularly during the 2015 - 2016 school year. This report presents the results of air sampling made on June 15, 2016.

**Spore Trap Sampling Report
For Glenwood Middle School
June 15, 2016**

I. BACKGROUND

Representatives from Aria Environmental, Inc. (AE) visited Glenwood Middle School on June 15, 2016 to perform air monitoring in response to an ongoing indoor air quality complaint at the school. Measurements for temperature, humidity, carbon monoxide, carbon dioxide and particulate matter and microbial spore trap sampling were collected from classrooms 8, 9, 15, 16, 31, 32, 37, 38 and Portable Classroom 70. Outdoor air samples were also collected for comparison purposes in one courtyard and outside near portable classroom 70. This monitoring was performed in response to employee and parental complaints and as a follow up to HVAC improvements.

There was no visible evidence of mold growth nor observed odors consistent with mildew in the classrooms sampled. Weather on the day of monitoring was sunny with a light breeze and it had rained earlier in the day. This was the next to last day of school. Lockers had been cleaned out, and teachers had been packing for the summer as well. Large, filled trash bins and debris from lockers were observed in the hallways.

II. OBSERVATIONS AND MEASUREMENTS

A. Observations and Measurements on June 15, 2016

Industry guidelines or standards for seasonal temperature and humidity ranges for thermal comfort are established by the American Society for Heating, Refrigerating and Air Conditioning Engineers (ASHRAE) standard 55-2013. These ranges are presented in Table 1. The U.S. Environmental Protection Agency (EPA) recommends maintaining indoor relative humidity below 60% and ideally between 30 and 50%. The room air temperature measured between 3:45 PM and 4:45 PM ranged from 74.3 to 76.8° F with an average of 75.0° F. The indoor relative humidity ranged from 46.2 to 61.4 percent. The temperature and humidity measurements were mostly acceptable compared to the comfort ranges. The comfort ranges are only set for the Summer and Winter seasons when temperatures are usually consistent. There are no Fall or Spring ranges because these seasons can include both heating and cooling modes of HVAC operation. The outside temperature at 4:50 PM was 79.6° F and the outdoor relative humidity was 67.9% outside near Portable Classroom 70, and the outside temperature at 4:59 PM was 83.2° F and the relative humidity was 55.2% in the outdoor courtyard. Windows were observed to be open in Room 14, and humid air was blowing out in to the hallway. Results of temperature, relative humidity, carbon dioxide and carbon monoxide monitoring are presented in Table 2.

**Table 1- Acceptable Ranges of Temperature and
Relative Humidity in Summer and Winter^a**

Relative Humidity	Winter Temperature	Summer Temperature
30%	68.5°F – 76.0°F	74.0°F – 80.0°F
40%	68.5°F - 75.5°F	73.5°F – 79.5°F
50%	68.5°F - 74.5°F	73.0°F – 79.0°F
60%	68.0°F - 74.0°F	72.5°F – 78.0°F

^aadapted from ASHRAE Standard 55-2013

Carbon dioxide and carbon monoxide measurements are used to assess ventilation system performance. The exhaled breath of building occupants is the main indoor source of carbon dioxide; therefore, the build-up of carbon dioxide indicates inadequate ventilation. Air monitoring was performed after school with the rooms unoccupied during sampling. Carbon

**Spore Trap Sampling Report
For Glenwood Middle School
June 15, 2016**

dioxide concentrations ranged from 285 to 538 ppm indoors. The concentration of concern for carbon dioxide is set by ASHRAE standard 62.1–2013 as 700 ppm above outdoor air. On the day of monitoring, the outdoor air concentration of carbon dioxide ranged from 234 to 244 ppm. Carbon dioxide concentrations were within the comfort parameters established by ASHRAE in all areas monitored.

Carbon monoxide is mainly attributed to incomplete combustion. Concentrations of CO were consistently 0.0 ppm indoors and outdoors and therefore were below the ASHRAE concentration of concern (9 ppm).

Particulate matter or PM is the term for a mixture of solid particles and liquid droplets found in the air. It does not distinguish between the types of particles in the air (e.g., pollen, skin cells, mold spores, soil, etc.). Particulate matter includes "inhalable coarse particles," with diameters larger than 2.5 micrometers and smaller than 10 micrometers (PM 10) and "fine particles," with diameters that are 2.5 micrometers and smaller (PM 2.5). Particle loads expected to be a part of the school environment include carpet and clothing fiber, soil tracked from outside, paper dust, chalk dust, and dust and fibers from building materials. ASHRAE Standard 62.1–2013 suggests target indoor concentrations for PM 2.5 and PM 10 of 15 $\mu\text{g}/\text{m}^3$ and 50 $\mu\text{g}/\text{m}^3$, respectively. These concentrations are taken from the EPA's National Ambient Air Quality Standards (NAAQS) based on annual arithmetic means deemed acceptable for outdoor air quality. Occupational standards and guidelines for particles are nearly an order of magnitude higher than concentrations typically found in non-occupational settings and are not appropriate for comparison.

Particle measurements were taken with an Aerocet 531 particulate monitor. The particle monitor takes a two minute averaged sample of particle concentrations in 5 size fractions (PM 1, PM 2.5, PM 7, PM 10 and total suspended particles (TSP)). Results of particulate monitoring, presented in Table 2, revealed that PM 2.5 and PM 10 particle concentrations were well below the ASHRAE target concentrations in all areas monitored.

**Spore Sampling Report
For Glenwood Middle School
June 15, 2016**

**Table 2: Particle, Temperature, Relative Humidity, Carbon Dioxide and Carbon Monoxide
Measurements Collected on June 15, 2016 at Glenwood Middle School**

Location	Time	PM1 ($\mu\text{g}/\text{m}^3$)	PM2.5 ($\mu\text{g}/\text{m}^3$)	PM7 ($\mu\text{g}/\text{m}^3$)	PM10 ($\mu\text{g}/\text{m}^3$)	TSP ($\mu\text{g}/\text{m}^3$)	Temp (°F)	Rh (%)	CO (ppm)	CO ₂ (ppm)
CR 08	3:45 PM	0	0	1	2	6	75.8	50.3	0.0	292
CR 09	3:46 PM	0	0	2	2	4	75.2	51.2	0.0	299
CR 15	3:58 PM	0	0	3	4	6	74.4	53.7	0.0	288
CR 16	3:59 PM	0	0	2	3	4	74.3	47.4	0.0	285
CR 31	4:10 PM	0	0	1	1	4	74.9	59.0	0.0	345
CR 32	4:11 PM	0	0	1	1	2	74.6	61.4	0.0	321
CR 37 (Music)	4:30 PM	0	0	6	8	10	76.0	48.2	0.0	368
CR 38 (Art)	4:31 PM	0	0	3	4	7	75.7	46.3	0.0	317
PCR 70	4:45 PM	0	0	1	1	2	76.8	46.2	0.0	538
Out 1	4:50 PM	0	1	7	9	14	79.6	67.9	0.0	244
Out 2 CY	4:59 PM	0	1	6	9	12	83.2	55.2	0.0	234

CR = Classroom; PCR = Portable Classroom; CY = Courtyard; Bold type indicates measurements outside of guidelines

**Spore Sampling Report
For Glenwood Middle School
June 15, 2016**

B. Air Monitoring for Fungal Identification and Counting on June 15, 2016

In the absence of visual sources of mold amplification and growth in the classrooms, non-viable spore trap samples were collected from eight classrooms within the main school building (Classrooms 8, 9, 15, 16, 31, 32, Music Room 37, Art Room 38), one portable classroom (70) and two outdoor locations to determine whether there was a difference between mold spore loads inside the building versus outside.

The spore trap samples were collected using AllergenCo-D cassettes attached to a Buck BioAire™ sampling pump calibrated to 15 liter per minute (LPM) air flow. The samples were collected for a period of ten minutes, the time period recommended for spore trap sampling in a clean indoor environment. The spore trap samples were submitted to Aerobiology Laboratory for analysis. The sample results are reported as the spores per cubic meter of air (spores per m³) of hyphal fragments and total fungal spores. Depending upon the morphology of the spores, they were counted by their unique genus or were grouped into spores exhibiting common characteristics (e.g., *Penicillium*/*Aspergillus* group). Tables 3 and 4 present the results of the spore trap samples collected at Glenwood Middle School on June 15, 2016.

Indoor spore counts ranged from 413 to 7,687 total spores per cubic meter of air (m³) in the main school building and 1,500 spores/m³ in the portable classroom on June 15, 2016. All indoor samples had total spore counts lower than the outdoor samples which ranged from 10,673 to 11,500 spores per m³. All individual spore types detected indoors had counts lower than the outdoor sample counts with the following exceptions: *Fusicladium* spores in Classroom 15 (7 spores/m³), *Penicillium*/*Aspergillus* group spores in Classroom 38 (133 spores/m³) and *Torula* spores in Classroom 16 (7 spores/m³). These spore counts were above the range of spores detected in the outdoor samples; however, the counts were generally considered low and not problematic.

The secondary colonizers *Chaetomium* and *Stachybotrys* were not detected in any samples. Hyphal elements were detected in three of the nine indoor samples with counts of 7 to 20 elements per m³. Hyphal elements were detected in both outdoor samples from 40 to 53 elements/m³. Variations in outdoor spore concentrations are a function of diurnal rhythms of spore release, weather-related factors (e.g., wind, rain, snow cover, temperature), and physical spatial factors. Certificates of analysis are included as Attachment B.

**Spore Sampling Report
For Glenwood Middle School
June 15, 2016**

Table 3: Results of Spore Trap Sampling in Selected Classrooms in Glenwood Middle School on June 15, 2016

Location	Outside (Out 1)	Outside in Courtyard (Out 2)	Room 8 (GM 08)	Room 9 (GM 09)	Room 15 (GM 15)	Room 16 (GM 16)	Room 31 (GM 31)	Room 32 (GM 32)	Room 37 (GM 37)	Room 38 (GM 38)
Spore Type	Spores/ m ³	Spores/ m ³	Spores/ m ³	Spores/ m ³	Spores/ m ³	Spores/ m ³	Spores/ m ³	Spores/ m ³	Spores/ m ³	Spores/ m ³
<i>Alternaria</i>	7	20	-	-	-	-	-	-	-	-
<i>Ascospores</i>	1,707	747	47	20	587	147	13	47	53	47
<i>Basidiospores</i>	7,360	7,787	1,227	1,440	5,707	1,000	313	2,987	2,027	987
<i>Cercospora</i>	7	-	-	-	-	-	-	-	-	-
<i>Cladosporium</i>	2,133	1,707	40	73	1,280	160	33	33	193	27
Clear Brown	7	-	-	-	-	-	-	-	-	-
<i>Drechslera/Bipolaris</i>	7	7	-	-	-	-	-	-	-	-
<i>Epicoccum</i>	40	53	-	-	-	-	-	-	-	-
<i>Fusicladium</i>	-	-	-	-	7	-	-	-	-	-
Hyphal Elements	53	40	-	13	-	7	-	-	-	20
<i>Oidium</i>	13	13	-	-	-	-	-	-	-	-
<i>Penicillium/Aspergillus</i>	40	107	20	-	60	27	40	13	13	133
<i>Pithomyces</i>	-	7	-	-	-	-	-	-	-	-
<i>Polythrincium</i>	13	13	-	-	-	7	-	-	-	-
Smuts, Periconia, <i>Myxomycetes</i>	107	160	-	-	47	7	13	-	13	7
<i>Torula</i>	-	-	-	-	-	7	-	-	-	-
Unknown	7	13	-	-	-	-	-	-	-	-
Total Fungi	11,500	10,673	1,333	1,547	7,687	1,360	413	3,080	2,300	1,220

Bold numbers represent spore concentrations above the outdoor counts. Dashes designate none detected.

**Spore Sampling Report
For Glenwood Middle School
June 15, 2016**

Location	Outside (Out 1)	Outside in Courtyard (Out 2)	Room 70 (GM 70)
Spore Type	Spores/ m ³	Spores/ m ³	Spores/ m ³
Alternaria	7	20	-
Ascospores	1,707	747	13
Basidiospores	7,360	7,787	1,467
Cercospora	7	-	-
Cladosporium	2,133	1,707	20
Clear Brown	7	-	-
Drechslera/Bipolaris	7	7	-
Epicoccum	40	53	-
Hyphal Elements	53	40	-
Oidium	13	13	-
Penicillium/Aspergillus	40	107	-
Pithomyces	-	7	-
Polythrincium	13	13	-
Smuts, Periconia, Myxomycetes	107	160	-
Unknown	7	13	-
Total Fungi	11,500	10,673	1,500

**Spore Sampling Report
For Glenwood Middle School
June 15, 2016**

III. CONCLUSIONS AND RECOMMENDATIONS

Aria Environmental, Inc. (AE) was contracted by Howard County Public School System to perform spore trap sampling at the Glenwood Middle School at the end of August 2015 due to air quality concerns expressed by staff and parents and to monitor the school after a recent heating, ventilation and air-conditioning (HVAC) system upgrade. AE made measurements for temperature, humidity, carbon monoxide, carbon dioxide and collected microbial spore trap samples on June 15, 2016.

Thermal comfort parameters of temperature and relative humidity were measured. Temperature and humidity measurements were mostly acceptable compared to comfort ranges. Carbon dioxide, carbon monoxide and particle measurements were within acceptable ranges for good indoor air quality in all areas monitored.

Indoor spore counts ranged from 413 to 7,687 total spores per cubic meter of air (m³) in the main school building and 1,500 spores/m³ in the portable classroom on June 15, 2016. All indoor samples had total spore counts lower than the outdoor samples which ranged from 10,673 to 11,500 spores per m³. All individual spore types detected indoors had counts lower than the outdoor sample counts with the following exceptions: *Fusicladium* spores in Classroom 15 (7 spores/m³), *Penicillium/Aspergillus* group spores in Classroom 38 (133 spores/m³) and *Torula* spores in Classroom 16 (7 spores/m³). These spore counts were above the range of spores detected in the outdoor samples; however, the counts were generally considered low and not problematic. Hyphal elements were detected in three of the nine indoor samples with counts of 7 to 20 elements per m³ which were below the hyphal elements detected in the outdoor samples (40 to 53 elements/m³). The secondary colonizers *Chaetomium* and *Stachybotrys* were not detected in any samples. Windows were observed open in Room 14 which may have affected sampling in Room 15.

Table 5 presents a summary of spore sampling results to date in the 2015 - 2016 school year. The indoor and outdoor ranges demonstrate the variable nature of spore counts.

Table 5 – Summary of Spore Sampling Results to Date at GMS in the 2015-2016 School Year

Date	Indoor Spore Count Range Spores per m³	Outdoor Spore Count Range Spores per m³
August 25, 2015	1,787 to 8,807	34,001 to 37,316
August 27, 2015	400 to 747	9,433 to 10,960
September 2, 2015	1,860 to 7,960	33,294 to 37,306
September 9, 2015	1,053 to 3,173	21,890 to 31,876
September 16, 2015	447 to 3,493	17,543 to 20,287
September 24, 2015	273 to 2,480	24,680 to 25,020
September 30, 2015	1,267 to 12,767	55,396 to 69,421
October 7, 2015	213 to 14,120	49,146 to 51,759
October 14, 2015	140 to 2,700	8,807 to 10,153
October 21, 2015	307 to 2,367	11,447 to 20,560
October 27, 2015	87 to 680	8,827 to 9,427
November 4, 2015	73 to 780	26,592 to 27,484
November 11, 2015	133 to 6,427	23,808 to 28,018
November 18, 2015	40 to 673	3,080 to 3,553
November 25, 2015	53 to 333	4,827 to 5,747
December 3, 2015	100 to 4,900	5,340 to 6,207

**Spore Sampling Report
For Glenwood Middle School
June 15, 2016**

Date	Indoor Spore Count Range Spores per m³	Outdoor Spore Count Range Spores per m³
December 9, 2015	40 to 187	10,940 to 11,087
December 16, 2015	33 to 1,320	5,920 to 11,995
December 21, 2015	33 to 373	5,673 to 6,600
December 28, 2015	160 to 1,513	9,253 to 15,073
January 19, 2016	40 to 300	200 to 307
January 27, 2016	0 to 113	127 to 167
February 4, 2016	7 to 493	4,093 to 4,367
February 10, 2016	7 to 40	127 to 180
February 18, 2016	13 to 127	200 to 240
February 26, 2016	7 to 260	87 to 173
March 2, 2016	7 to 33	113 to 167
March 9, 2016	20 to 800	3,060 to 3,840
March 16, 2016	60 to 14,672	19,510 to 23,190
March 22, 2016	13 to 1,867	2,173 to 2,220
March 30, 2016	67 to 3,167	1,660 to 2,333
April 5, 2016	7 to 120	980 to 10,960
April 13, 2016	73 to 320	2,000 to 3,067
April 20, 2016	13 to 127	480 to 36,379
April 27, 2016	253 to 7,007	15,360 to 17,160
May 4, 2016	573 to 4,707	42,032 to 48,752
May 12, 2016	487 to 12,727	42,236 to 65,628
May 18, 2016	360 to 6,207	21,406 to 25,773
May 25, 2016	213 to 1,160	10,147 to 16,253
June 1, 2016	427 to 1,047	34,780 to 73,216
June 8, 2016	327 to 7,807	25,463 to 26,061
June 15, 2016	413 to 7,687	10,673 to 11,500

Spore measurements collected in classrooms were generally acceptable compared to outdoor samples with outdoor total spore counts 5 times higher on average than the indoor counts. Indoor sample total spore counts and individual spore counts were all lower than the outdoor sample counts with the exceptions described above. Follow up air sampling has not been scheduled because of summer renovations. Air sampling will be performed regularly in order to monitor changes in conditions affected by seasonal variations and the new HVAC system.

IV. LIMITATIONS

This report has been prepared for the exclusive use of the Howard County Public School System and/or their agents. This service has been performed in accordance with generally accepted environmental practices. No other warranty, expressed or implied, is made. Our conclusions and recommendations are based, in part, upon information provided to us by others and our site observations. We have not verified the completeness or accuracy of the information provided to us by others, unless otherwise noted. Our observations and recommendations are based upon conditions readily visible at the site at the time of our site visit, and upon current industry standards. Destructive sampling was not performed as part of this survey. No observations were made behind solid walls, ceilings or in pipe chases that weren't already openly visible.

By virtue of providing the services described in this report, the preparer does not assume the responsibility of the person(s) in charge of the site, or otherwise undertake responsibility for


**Spore Sampling Report
For Glenwood Middle School
June 15, 2016**

reporting to any local, state, or federal public agencies any conditions at the site that may present a potential danger to public health, safety, or the environment. It is the Client's responsibility to notify the appropriate local, state, or federal public agencies as required by law, or otherwise to disclose, in a timely manner, any information that may be necessary to prevent any danger to public health, safety, or the environment. Under this scope of services, the preparer assumes no responsibility regarding response actions (e.g. abatement, removal, etc.) initiated as a result of these findings. Response actions are the sole responsibility of the Client and should be conducted in accordance with local, state, and/or federal requirements, and should be performed by appropriately licensed personnel as warranted.

Attachment A:

Building Layout and Sample Location Plan for June 15, 2016

Spore sampling locations
for June 15, 2016

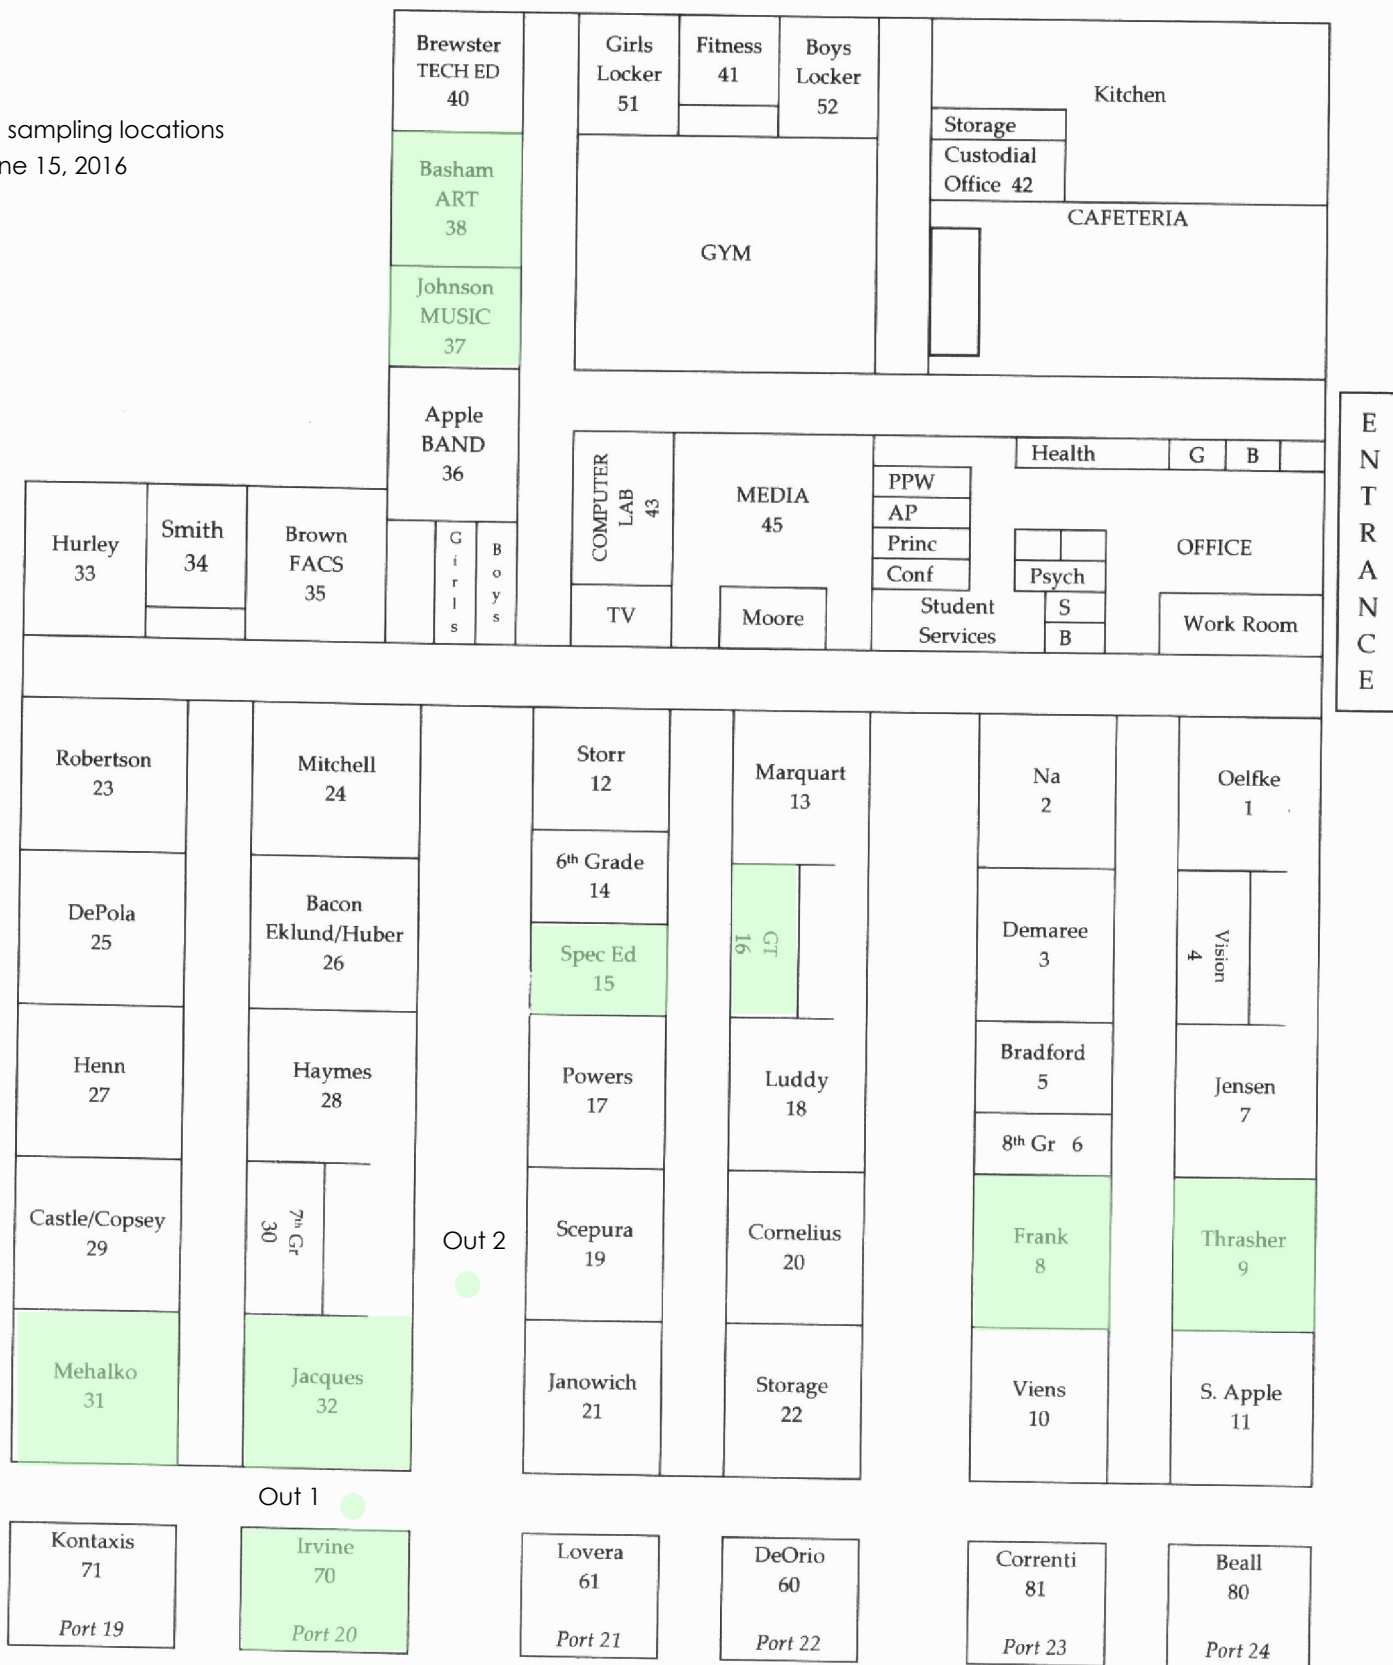

Glenwood Middle School Floor Plan

As of 8/02/13



Attachment B:

**Report of Analysis and Chain of Custody Forms
June 15, 2016**

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939
Page 1 of 11

1054 Spore Trap Analysis: SOP 3.8

Client Sample Number	GM-08				Out 1			
Sample Location	Room 8				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-001				16018939-010			
Spore Identification	Raw Ct	spr/m³	% Ttl	In/Out	Raw Ct	spr/m³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	7	47	3	1/37	16	1707	15	-
basidiospores	23	1227	92	1/6	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	6	40	3	1/53	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	-	-	-	-	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	3	20	1	1/2	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	-	-	-	-	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
	Debris Rating 2				Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m³				Analytical Sensitivity: 7 spr/m³			
Comments								
Total *See Footnotes	39	1333	~100%	1/9	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939
Page 2 of 11

Client Sample Number	GM-09				Out 1			
Sample Location	Room 9				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-002				16018939-010			
Spore Identification	Raw Ct	spr/m³	% Ttl	In/Out	Raw Ct	spr/m³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	3	20	1	1/85	16	1707	15	-
basidiospores	27	1440	93	1/5	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	11	73	5	1/29	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	2	13	1	1/4	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	-	-	-	-	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	-	-	-	-	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
	Debris Rating 3				Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m³				Analytical Sensitivity: 7 spr/m³			
Comments								
Total *See Footnotes	43	1547	~100%	1/7	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939

Page 3 of 11

Client Sample Number	GM-15				Out 1			
Sample Location	Room 15				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-003				16018939-010			
Spore Identification	Raw Ct	spr/m ³	% Ttl	In/Out	Raw Ct	spr/m ³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	11	587	8	1/3	16	1707	15	-
basidiospores	107	5707	74	1/1	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	24	1280	17	1/2	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
Fusicladium	1	7	<1	-	-	-	-	-
hyphal elements	-	-	-	-	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	9	60	1	2/1	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	7	47	1	1/2	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
Debris Rating 3					Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m ³				Analytical Sensitivity: 7 spr/m ³			
Comments								
Total *See Footnotes	159	7687	~100%	1/1	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939

Page 4 of 11

Client Sample Number	GM-16				Out 1			
Sample Location	Room 16				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-004				16018939-010			
Spore Identification	Raw Ct	spr/m ³	% Ttl	In/Out	Raw Ct	spr/m ³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	22	147	11	1/12	16	1707	15	-
basidiospores	150	1000	74	1/7	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	24	160	12	1/13	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	1	7	<1	1/8	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	4	27	2	1/2	6	40	<1	-
Polythrincium	1	7	<1	1/2	2	13	<1	-
Smuts,Periconia,Myxomycetes	1	7	<1	1/16	16	107	1	-
Torula	1	7	<1	-	-	-	-	-
Unknown	-	-	-	-	1	7	<1	-
Debris Rating 2					Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m ³				Analytical Sensitivity: 7 spr/m ³			
Comments								
Total *See Footnotes	204	1360	~100%	1/8	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939

Page 5 of 11

Client Sample Number	GM-31				Out 1			
Sample Location	Room 31				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-005				16018939-010			
Spore Identification	Raw Ct	spr/m ³	% Ttl	In/Out	Raw Ct	spr/m ³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	2	13	3	1/128	16	1707	15	-
basidiospores	47	313	76	1/23	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	5	33	8	1/64	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	-	-	-	-	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	6	40	10	1/1	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	2	13	3	1/8	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
Debris Rating 3					Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m ³				Analytical Sensitivity: 7 spr/m ³			
Comments								
Total *See Footnotes	62	413	~100%	1/28	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939

Page 6 of 11

Client Sample Number	GM-32				Out 1			
Sample Location	Room 32				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-006				16018939-010			
Spore Identification	Raw Ct	spr/m ³	% Ttl	In/Out	Raw Ct	spr/m ³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	7	47	2	1/37	16	1707	15	-
basidiospores	28	2987	97	1/2	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	5	33	1	1/64	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	-	-	-	-	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	2	13	<1	1/3	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	-	-	-	-	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
	Debris Rating 2				Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m ³				Analytical Sensitivity: 7 spr/m ³			
Comments								
Total *See Footnotes	42	3080	~100%	1/4	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939

Page 7 of 11

Client Sample Number	GM-37				Out 1			
Sample Location	Room 37				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-007				16018939-010			
Spore Identification	Raw Ct	spr/m³	% Ttl	In/Out	Raw Ct	spr/m³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	8	53	2	1/32	16	1707	15	-
basidiospores	76	2027	88	1/4	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	29	193	8	1/11	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	-	-	-	-	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	2	13	1	1/3	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	2	13	1	1/8	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
	Debris Rating 3				Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m³				Analytical Sensitivity: 7 spr/m³			
Comments								
Total *See Footnotes	117	2300	~100%	1/5	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939

Page 8 of 11

Client Sample Number	GM-38				Out 1			
Sample Location	Room 38				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-008				16018939-010			
Spore Identification	Raw Ct	spr/m ³	% Ttl	In/Out	Raw Ct	spr/m ³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	7	47	4	1/37	16	1707	15	-
basidiospores	37	987	81	1/7	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	4	27	2	1/80	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	3	20	2	1/3	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	20	133	11	3/1	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	1	7	1	1/16	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
Debris Rating 3					Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m ³				Analytical Sensitivity: 7 spr/m ³			
Comments								
Total *See Footnotes	72	1220	~100%	1/9	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939

Page 9 of 11

Client Sample Number	GM-70				Out 1			
Sample Location	Portable Classroom 70				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-009				16018939-010			
Spore Identification	Raw Ct	spr/m ³	% Ttl	In/Out	Raw Ct	spr/m ³	% Ttl	In/Out
Alternaria	-	-	-	-	1	7	<1	-
ascospores	2	13	1	1/128	16	1707	15	-
basidiospores	55	1467	98	1/5	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	3	20	1	1/107	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	-	-	-	-	1	7	<1	-
Epicoccum	-	-	-	-	6	40	<1	-
hyphal elements	-	-	-	-	8	53	<1	-
Oidium	-	-	-	-	2	13	<1	-
Penicillium/Aspergillus group	-	-	-	-	6	40	<1	-
Polythrincium	-	-	-	-	2	13	<1	-
Smuts,Periconia,Myxomycetes	-	-	-	-	16	107	1	-
Unknown	-	-	-	-	1	7	<1	-
	Debris Rating 3				Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m ³				Analytical Sensitivity: 7 spr/m ³			
Comments								
Total *See Footnotes	60	1500	~100%	1/8	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939
Page 10 of 11

Client Sample Number	Out 2 CY				Out 1			
Sample Location	Outside Courtyard				Outside			
Sample Volume (L)	150				150			
Lab Sample Number	16018939-011				16018939-010			
Spore Identification	Raw Ct	spr/m³	% Ttl	In/Out	Raw Ct	spr/m³	% Ttl	In/Out
Alternaria	3	20	<1	3/1	1	7	<1	-
ascospores	7	747	7	1/2	16	1707	15	-
basidiospores	73	7787	73	1/1	69	7360	64	-
Cercospora	-	-	-	-	1	7	<1	-
Cladosporium	16	1707	16	1/1	20	2133	19	-
Clear brown	-	-	-	-	1	7	<1	-
Drechslera/Bipolaris group	1	7	<1	1/1	1	7	<1	-
Epicoccum	8	53	<1	1/1	6	40	<1	-
hyphal elements	6	40	<1	1/1	8	53	<1	-
Oidium	2	13	<1	1/1	2	13	<1	-
Penicillium/Aspergillus group	16	107	1	3/1	6	40	<1	-
Pithomyces	1	7	<1	-	-	-	-	-
Polythrincium	2	13	<1	1/1	2	13	<1	-
Smuts,Periconia,Myxomycetes	24	160	1	2/1	16	107	1	-
Unknown	2	13	<1	2/1	1	7	<1	-
	Debris Rating 3				Debris Rating 3			
Analytical Sensitivity	Analytical Sensitivity: 7 spr/m³				Analytical Sensitivity: 7 spr/m³			
Comments								
Total *See Footnotes	161	10673	~100%	1/1	150	11500	~100%	-

Aria Environmental
P.O. Box 286
Woodbine, Maryland 21797
Attn: Julie Barth
Project: **J15-876 GMS Glenwood MS**
Condition of Sample(s) Upon Receipt: Acceptable

Date Collected: 06/15/2016
Date Received: 06/17/2016
Date Analyzed: 06/21/2016
Date Reported: 06/22/2016
Project ID: 16018939
Page 11 of 11

Footnotes and Additional Report Information

Debris Rating Table

1	Minimal (<5%) particulate present	Reported values are minimally affected by particulate load.
2	5% to 25% of the trace occluded with particulate	Negative bias is expected. The degree of bias increases directly with the percent of the trace that is occluded.
3	26% to 75% of the trace occluded with particulate	Negative bias is expected. The degree of bias increases directly with the percent of the trace that is occluded.
4	75% to 90% of the trace occluded with particulate	Negative bias is expected. The degree of bias increases directly with the percent of the trace that is occluded.
5	Greater than 90% of the trace occluded with particulate	Quantification not possible due to large negative bias. A new sample should be collected at a shorter time interval or other measures taken to reduce particulate load.

1. Penicillium/Aspergillus group spores are characterized by their small size, round to ovoid shape, being unicellular, and usually colorless to lightly pigmented. There are numerous genera of fungi whose spore morphology is similar to that of the Penicillium/Aspergillus type. Two common examples would be Paecilomyces and Acremonium. Although the majority of spores placed in this group are Penicillium, Aspergillus, or a combination of both. Keep in mind that these are not the only two possibilities.

2. Ascospores are sexually produced fungal spores formed within an ascus. An ascus is a sac-like structure designed to discharge the ascospores into the environment, e.g. Ascobolus.

3. Basidiospores are typically blown indoors from outdoors and rarely have an indoor source. However, in certain situations a high basidiospore count indoors may be indicative of a wood decay problem or wet soil.

4. The colorless group contains colorless spores which were unidentifiable to a specific genus. Examples of this group include Acremonium, Aphanocladium, Beauveria, Chrysosporium, Engyodontium microconidia, yeast, some arthrospores, as well as many others.

5. Hyphae are the vegetative mode of fungi. Hyphal elements are fragments of individual Hyphae. They can break apart and become airborne much like spores and are potentially allergenic. A mass of hyphal elements is termed the mycelium. Hyphae in high concentration may be indicative of colonization.

6. Dash (-) in this report, under raw count column means 'not detected (ND)'; otherwise 'not applicable' (NA).

7. The positive-hole correction factor is a statistical tool which calculates a probable count from the raw count, taking into consideration that multiple particles can impact on the same hole; for this reason the sum of the calculated counts may be less than the positive hole corrected total.

8. Due to rounding totals may not equal 100%.

9. Analytical Sensitivity for each spores is different for Non-viable sample when the spores are read at different percentage. Analytical Sensitivity is calculated as spr/m^3 divided by raw count. $\text{spr}/\text{m}^3 = \text{raw counts} \times (100/\% \text{ read}) \times (1000/\text{Sample volume})$. If Analytical Sensitivity is 13 spr/m^3 at 100% read, Analytical Sensitivity at 50% read would be 27 spr/m^3 , which is 2 times higher.

10. Minimum Reporting Limits (MRL) for BULKS, DUSTS, SWABS, and WATER samples are a calculation based on the sample size and the dilution plate on which the organism was counted. Results are a compilation of counts taken from multiple dilutions and multiple medias. This means that every genus of fungi or bacteria recovered can be counted on the plate on which it is best represented.

11. If the final quantitative result is corrected for contamination based on the blank, the blank correction is stated in the sample comments section of the report.

12. Analysis conducted on non-viable spore traps is completed using Indoor Environmental Standards Organization (IESO) Standard 2210.


13. The results in this report are related to this project and these samples only.

14. For samples with an air volume of < 100L, the number of significant figures in the result should be considered (2) two. For samples with air volumes between 100-999L, the number of significant figures in the result should be considered (3) three. For example, a sample with a result of 55,443 spr/m^3 from a 75L sample using significant figures should be considered 55,000. The same result of 55,443 from a 150L sample using significant figures should be considered 55,400 spr/m^3 .

15. If the In/Out ratio is greater than 100 times it is indicated >100/1, rather than showing the real value.

Terminology Used in Direct Exam Reporting

Conidiophores are a type of modified hyphae from which spores are born. When seen on a surface sample in moderate to numerous concentrations they may be indicative of fungal growth.



Suzanne S. Blevins, B.S., SM (ASCP)
Laboratory Director

16 018939

16018939



NVLAP Lab Code 200860-Q (CO)
NVLAP Lab Code 200829-Q (VA)
NVLAP Lab Code 500097-Q (AZ)



LAB #192683 (CO)
LAB #102977 (GA)
LAB #163063 (VA)
LAB #210229 (AZ)

AZ, CO, GA, VA, NJ

Aerobiology Client		Aria Environmental, Inc.	
Field Contact	Julie Barth	Collected By/Date:	06/15/16
Reporting Address	PO Box 286, Woodbine, MD 21797	Relinquished By/Date:	06/16/16
Billing Address	SAME	Received By/Date:	6/17/16
Phone/Fax	410-549-5774/410-549-4488	Sampler Type	Andersen SAS
Reporting Email (s)	jbarth@ariaenviro.com	Sample/Aire	AeroTrap
Routine	<input checked="" type="radio"/> 24 Hour <input type="radio"/> Same Day <input type="radio"/> 4 Hour <input type="radio"/> 2 Hour	PO#/Job#:	J15-876 GMS
		Project Name:	Glenwood MS
		5 Day (Asbestos Only)	Notes:
SAMPLING LOCATION ZIP CODE		21738	
		CC Info:	

Sample No.	Test Code	Sample Location	Total Volume/Area
1 GM-08	1054	Room 8	150 L
2 GM-09	1054	Room 9	150 L
3 GM-15	1054	Room 15	150 L
4 GM-16	1054	Room 16	150 L
5 GM-31	1054	Room 31	150 L
6 GM-32	1054	Room 32	150 L
7 GM-37	1054	Room 37	150 L
8 GM-38	1054	Room 38	150 L
9 GM-70	1054	Portable Classroom 70	150 L
10 Out 1	1054	Outside	150 L
11 Out 2 CY	1054	Outside Courtyard	150 L
12			
13			
14			

1054	Direct, Non-viable Spore Trap	1015	Culture - WATER Legionella
1051	Direct, Qualitative- Swab/Tape	1017	Culture - SWAB Legionella
1050	Direct, Qualitative- Bulk	1010	WATER - Potable - E. coli/total coliforms
1005	AIR Culture - Bacterial Count w/ ID's	1012	SWAB - E. coli/total coliforms
1030	AIR Culture - Fungal Count w/ ID's	1028	Sewage Screen (E. coli/Enterococcus/fecal coliforms)
1006	SWAB Culture - Bacterial Count w/ ID's	2056	Heterotrophic Plate Count
1031	SWAB Culture - Fungal Count w/ ID's	3001	ASBESTOS - Point count
1008	BULK Culture - Bacterial Count w/ ID's	3002	ASBESTOS - PLM Analysis
1033	BULK Culture - Fungal Count w/ ID's	3003	ASBESTOS - Particle characterization
1007	WATER Culture - Bacterial Count w/ID's	3004	ASBESTOS - PCM Analysis